


DOOR SCHEDULE

NO.	WIDTH	HEIGHT	THICK/MAT.	FINISH TYPE	FIRE RATING	FRAMES MAT.	FINISH	REMARKS
1	18'-10"	10'-0"	1 3/4	WOOD SEMI GLASS	-	WOOD DR	SEMI GLASS	ENTRANCE DOOR, HAND DOORS & OPERABLE TRANSOM WINDOWS
2	3'-6"	8'-0"	1 3/4	METAL SEMI GLASS	-	METAL	SEMI GLASS	EXTERIOR DOOR AT REAR SERVICE ROOM
3	3'-0"	8'-0"	1 3/8	WOOD SEMI GLASS	-	WOOD DR	SEMI GLASS	INTERIOR DOOR
4	3'-0"	8'-0"	1 3/4	METAL SEMI GLASS	-	METAL	SEMI GLASS	WALK-IN FRIDGE DOOR
5	6'-9"	8'-0"	1 3/4	METAL SEMI GLASS	-	METAL	SEMI GLASS	ROLL-UP DOOR AT TRASH
6	5'-6"	4'-6"	1 3/4	METAL SEMI GLASS	-	METAL	SEMI GLASS	METAL GATE AT ROOF FOR ACCESS TO MECH. EQUIPMENT

WINDOW SCHEDULE

NO.	WIDTH	HEIGHT	GLAZ.	MAT.	FINISH	TYPE	REMARKS
1	5'-6.5"	10'-0"	SINGLE	WOOD	SEMI GLASS	FIXED/awning	TEMPERED GLASS
2	16'-10.5"	4'-0"	SINGLE	WOOD	SEMI GLASS	FIXED	TWO SHEETS OF GLASS IN SINGLE FRAME, SILICONE CALK JOINT

-ALL DOORS SHALL BE SOLID CORE
 -PROVIDE DOOR STOPS AT ALL INTERIOR DOORS
 -EXTERIOR DOORS MUST OPEN OVER A LANDING NOT MORE THAN 1/2" BELOW THE THRESHOLD. EXCEPTION PROVIDING THE DOOR DOES NOT SWING OVER THE LANDING, LANDING SHALL NOT BE MORE THAN 8" BELOW THRESHOLD.
 -VERIFY ALL DIMENSIONS WITH MANUFACTURER PRIOR TO DOOR & WINDOW FABRICATION
 -ALL DOORS CONTAINING GLAZING ARE TO BE TEMPERED WHERE REQUIRED BY CODE UNLESS OTHERWISE NOTED.
 -EXIT DOORS SHALL BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT PER SECTION 1003.1B

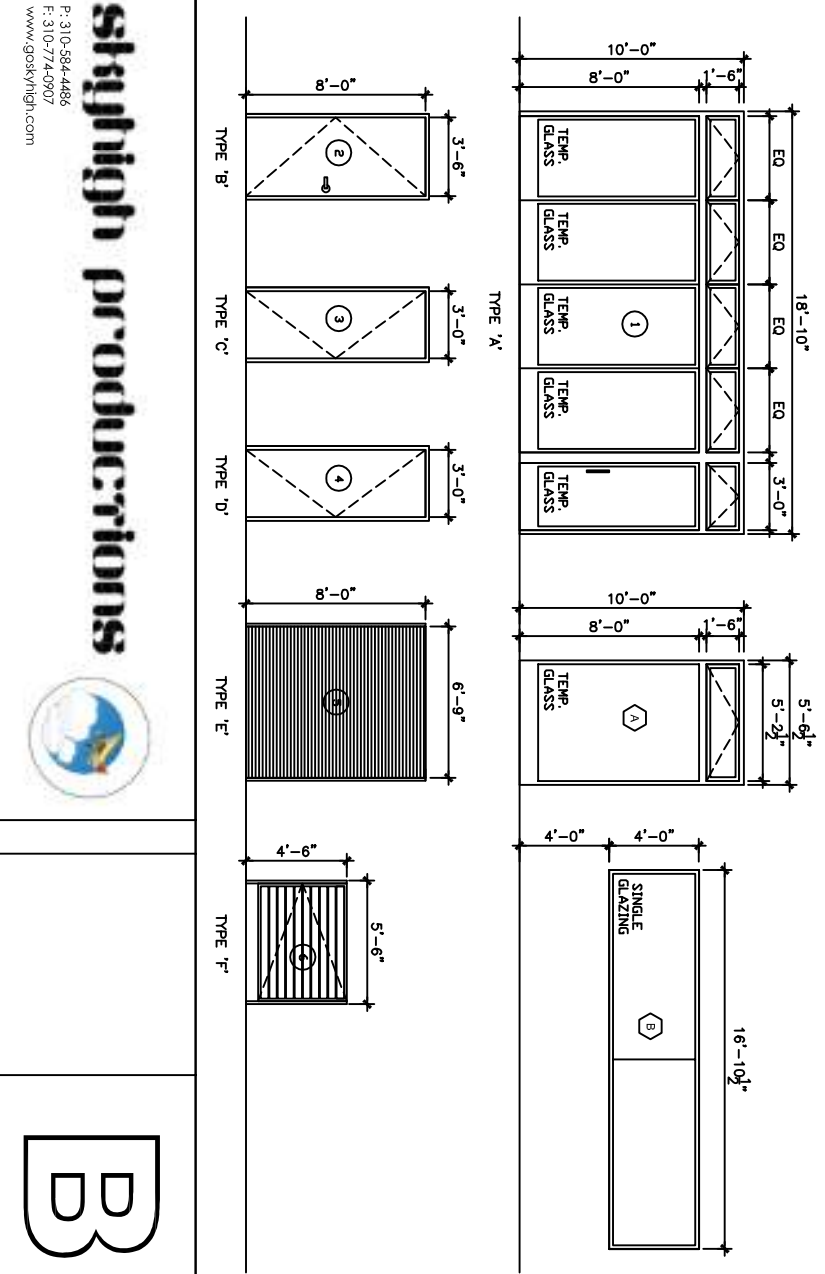

GROUND FLOOR PLAN

SCALE: 1/4" = 1'-0"

LEGEND

- EXISTING, RECONSTRUCTED, OR NEW EXTERIOR WALLS
- INTERIOR TI NON-STRUCTURAL WALLS
- EXISTING EXTERIOR WALLS
- WINDOW TYPE - SEE SHEET A1.2
- DOOR TYPE - SEE SHEET A1.2
- DOWNSPOUT
- HARD WIRE INTERCONNECTED SMOKE DETECTOR
- CEILING FAN

PROJECT NORTH

TRUE NORTH

DATE: _____ ISSUE/REVISION: _____

GROUND FLOOR PLAN

1/4" = 1'-0"

A 4